


Transformer Rated Sockets


Florida Power and Light | Duke | TECO




UAPC4512-O-TS0325

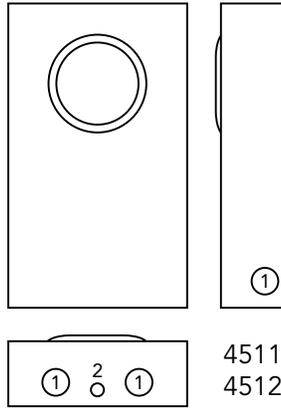

4511
4512

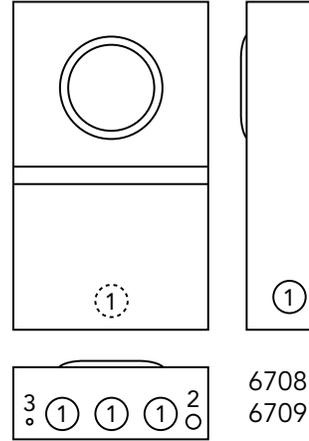

6708
6709

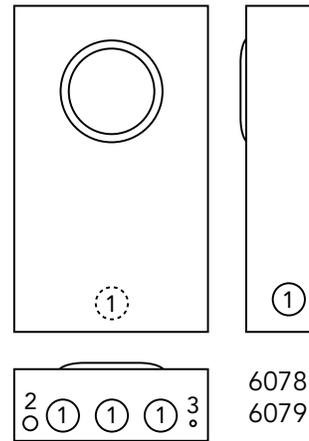

6078
6079

20 Amp | Instrument Rated Meter Sockets | Ringless

Catalog Number	Approving Utilities	Terminals	Pre-Wired	Material	Hub	Dimensions			Knockouts		
						D"	W"	H"	1	2	3
UC6078-XL-21-DEF	Duke	8	Yes	Steel	C.P.	4 $\frac{1}{8}$	12	20	1 $\frac{1}{2}$	$\frac{1}{4}$, $\frac{1}{2}$	$\frac{1}{4}$
UC6079-XL-21-DEF	Duke	13	Yes	Steel	C.P.	4 $\frac{1}{8}$	12	20	1 $\frac{1}{2}$	$\frac{1}{4}$, $\frac{1}{2}$	$\frac{1}{4}$
UAPC4511-O-11	FP&L	6	No	Aluminum	Blank	4 $\frac{1}{8}$	12	20	1 $\frac{1}{4}$	$\frac{1}{4}$, $\frac{1}{2}$	—
UAPC4512-O-11	FP&L	13	No	Aluminum	Blank	4 $\frac{1}{8}$	12	20	1 $\frac{1}{4}$	$\frac{1}{4}$, $\frac{1}{2}$	—
U6708-XL-21	TECO	6	Yes	Steel	C.P.	4 $\frac{1}{8}$	12	20	1 $\frac{1}{2}$	$\frac{1}{4}$, $\frac{1}{2}$	$\frac{1}{4}$
UAP6708-XL-21	TECO	6	Yes	Aluminum	C.P.	4 $\frac{1}{8}$	12	20	1 $\frac{1}{2}$	$\frac{1}{4}$, $\frac{1}{2}$	$\frac{1}{4}$
U6709-XL-21	TECO	13	Yes	Steel	C.P.	4 $\frac{1}{8}$	12	20	1 $\frac{1}{2}$	$\frac{1}{4}$, $\frac{1}{2}$	$\frac{1}{4}$
UAP6709-XL-21	TECO	13	Yes	Aluminum	C.P.	4 $\frac{1}{8}$	12	20	1 $\frac{1}{2}$	$\frac{1}{4}$, $\frac{1}{2}$	$\frac{1}{4}$
UAC7478-XL-381	FP&LP	6	Yes	Aluminum	C.P.	4 $\frac{1}{8}$	12	20	1 $\frac{1}{2}$	$\frac{1}{4}$, $\frac{1}{2}$	—
UAC7444-XL-331	FP&LP	8	Yes	Aluminum	C.P.	4 $\frac{1}{8}$	12	20	1 $\frac{1}{2}$	$\frac{1}{4}$, $\frac{1}{2}$	—
UAC7445-XL-2131	FP&LP	13	Yes	Aluminum	C.P.	4 $\frac{1}{8}$	12	20	1 $\frac{1}{2}$	$\frac{1}{4}$, $\frac{1}{2}$	—

Utility requirements for this equipment may vary. Always consult the serving utility for their requirements prior to ordering or installing this equipment. This product must be installed by a licensed electrician. Installation of this equipment may require local electrical inspector approval.



Current Transformer Cabinets

Florida Power and Light | Duke | TECO



323412-SC3RA-SP

Current Transformer Cabinets | Type 3R

Catalog Number	Approving Utilities	Material	Max # of Conduits	Max # & Size Conductors	Dimensions		
					D"	W"	H"
323412-SC3RA-SP	FP&L	TC-3 Aluminum	8 (4")	8 (600C) or 8 (400A)	12	32	34
304614-SC3RA-SP	FP&L	TC-5 Aluminum	8 (4")	16 (600C) or 16 (400A)	14½	30	46
303012-CT3RA-WB	TECO	Aluminum	—	—	12	30	30
363612-CT3RXA-SP1	TECO	Aluminum	—	—	12	36	36
363614-CT3RXA-FPLP	FP&LP	Aluminum	—	—	14	36	36
323412-SC3R-DUKE	Duke	Steel	—	—	12	32	34
323412-SC3RA-DUKE	Duke	Aluminum	—	—	12	32	34
404014-CT3R-DUKE	Duke	Steel	—	—	14	40	40
404014-CT3RA-DUKE	Duke	Aluminum	—	—	14	40	40

Utility requirements for this equipment may vary. Always consult the serving utility for their requirements prior to ordering or installing this equipment. This product must be installed by a licensed electrician. Installation of this equipment may require local electrical inspector approval.

