





U2819-O-PSEG-DES



| | | | |
|-------------------------------|---|---------------------------|--|
| Catalog Number | U2819-O-PSEG-DES | Mounting | Surface Mount |
| Marketing Product Description | 13 Terminal Ringless Plain Top Test Switch Prewired Add Inhibitor Configuration 21 Public Service Electric And Gas New Jersey | Enclosure | G90 Galvanized Steel with Powder Coat Finish |
| UPC | 784572222717 | Jaw Quantity | 13 Terminal |
| Length (IN) | 4.125 | Bypass Type | No Bypass |
| Width (IN) | 12 | Number of Meter Positions | 1 Position |
| Height (IN) | 20 | Equipment Ground | Ground Lug |
| Brand Name | Milbank | Hub Opening | Plain Top |
| Type | Ringless Meter Socket | Line Side Wire Range | 4 - 14 AWG |
| Application | Meter Socket | Load Side Wire Range | 4 - 14 AWG |
| Standard | UL Listed; Type 3R | Number Of Receptacles | 0 |
| Voltage Rating | 600 Volts Alternating Current | | |
| Amperage Rating | 20 Continuous Ampere | | |
| Phase | 3 Phase | | |
| Frequency Rating | 60 Hertz | | |
| Size | 4.125L x 12W x 20H | | |
| Number Of Cutouts | 0 | | |
| Cutout Size | No Main Breaker | | |
| Cable Entry | Underground | | |
| Terminal | Single Mechanical | | |
| Insulation | Glass Polyester | | |

Please consult serving utility for their requirements prior to ordering or installing, as specifications and approvals vary by utility and may require local electrical inspector approval. All installations must be installed by a licensed electrician and must comply with all national and local codes, laws and regulations. Milbank reserves the right to make changes in specifications and features shown without notice or obligation.

| FEATURE TABLE | | |
|---------------|-----|-------------------------------|
| ITEM | QTY | DESCRIPTION |
| A | 4 | STD. MNTG. EMBOSSED |
| B | 1 | 1/4, 1/2 CONC. K.O. |
| C | 2 | 1 1/2, 2 CONC. K.O. |
| D | 3 | 1, 1 1/4, 1 1/2, 2 CONC. K.O. |

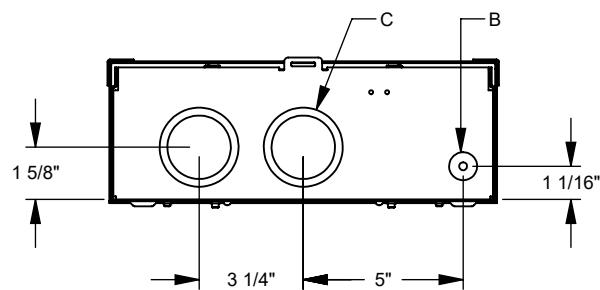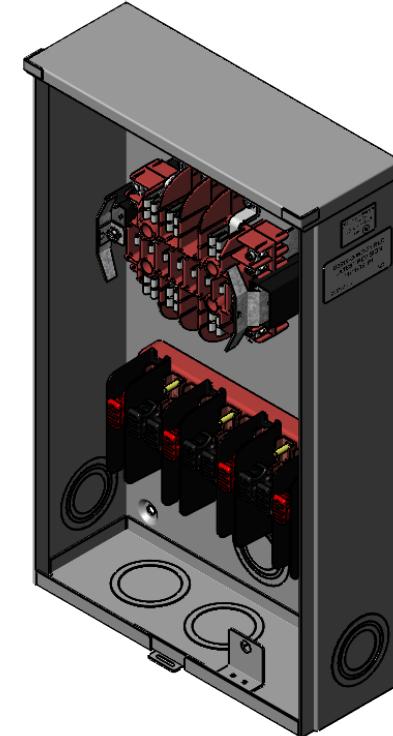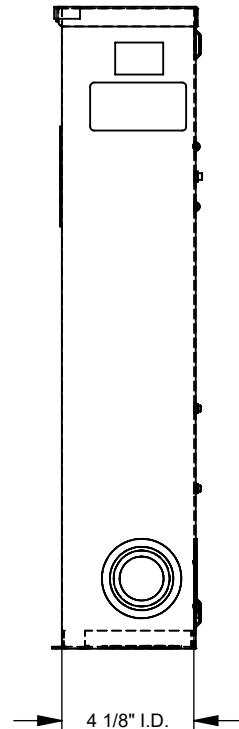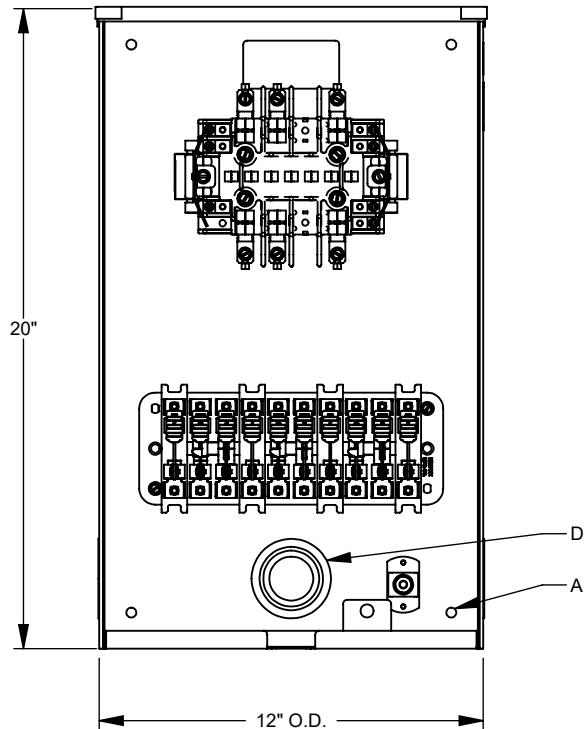

All dimensions are +/- 1/16".
Drawing views are not to scale.

Version:

1

Please consult serving utility for their requirements prior to ordering or installing, as specifications and approvals vary by utility, and may require local electrical inspector approval. All installations must be installed by a licensed electrician and must comply with all national and local codes, laws and regulations. Milbank reserves the right to make changes in specifications and features shown without notice or obligation.