

# U4667-XT-9526







Catalog Number	U4667-XT-9526	Enclosure	G90 Galvanized Steel with Powder Coat Finish
Marketing Product Description	7 Terminal Bolt-in 2 Large Closing Plates Link Bypass Configuration 9526	Jaw Quantity	7 Terminal
UPC	784572300613	Bypass Type	Link Bypass
Length (IN)	6	Number of Meter Positions	1 Position
Width (IN)	20.25	Equipment Ground	2 Barrel Ground Lug
Height (IN)	43	Hub Opening	Twin Large Closing Plates
Brand Name	Milbank	Number Of Receptacles	0
Type	Bolt On Meter Socket		
Application	Meter Socket		
Standard	UL Listed; Type 3R		
Voltage Rating	600 Volts Alternating Current		
Amperage Rating	480 Continuous Ampere		
Phase	3 Phase		
Frequency Rating	60 Hertz		
Size	6L x 20.25W x 43H		
Number Of Cutouts	0		
Cutout Size	No Main Breaker		
Cable Entry	Overhead or Underground		
Terminal	1/2 Inch Stud Line Side		
Insulation	Glass Polyester		
Mounting	Surface Mount		

Please consult serving utility for their requirements prior to ordering or installing, as specifications and approvals vary by utility and may require local electrical inspector approval. All installations must be installed by a licensed electrician and must comply with all national and local codes, laws and regulations. Milbank reserves the right to make changes in specifications and features shown without notice or obligation.

**FEATURE TABLE**

ITEM	QTY	DESCRIPTION
A	4	U/L MNTG.EMBOSS
B	1	1/4 SOLID K.O.
C	2	1/2, 1/4 CONC. K.O.
D	7	3, 3 1/2, 4 CONC. K.O.

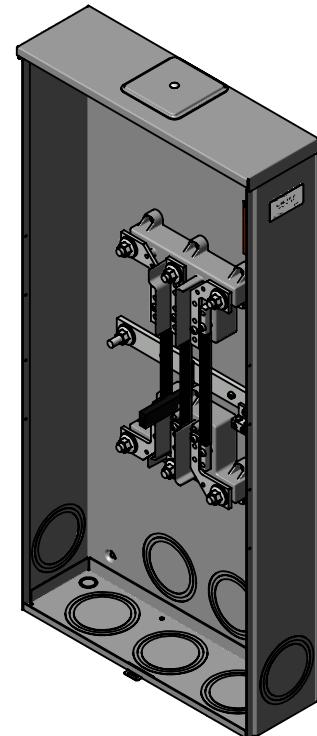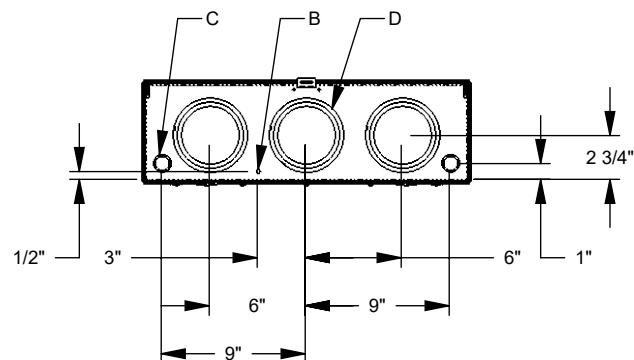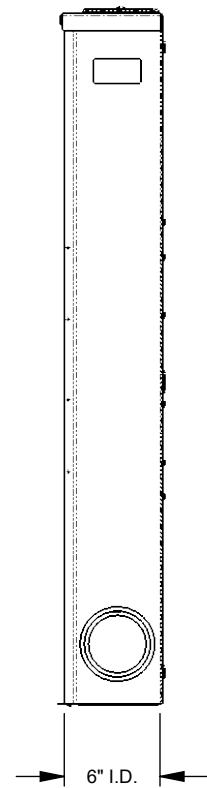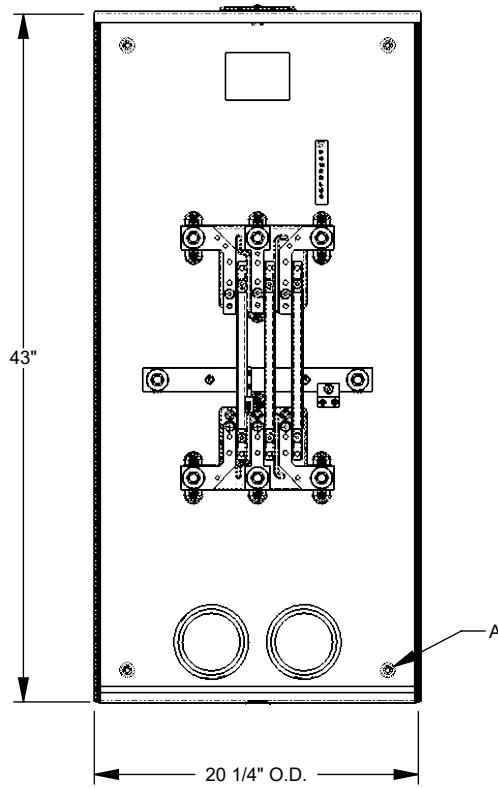

All dimensions are +/- 1/16".  
Drawing views are not to scale.

Version:

**1**

Please consult serving utility for their requirements prior to ordering or installing, as specifications and approvals vary by utility, and may require local electrical inspector approval. All installations must be installed by a licensed electrician and must comply with all national and local codes, laws and regulations. Milbank reserves the right to make changes in specifications and features shown without notice or obligation.