



## U5300-XL-75






Catalog Number	U5300-XL-75	Cutout Size	One Single Pole 20 Ampere Breaker and One Single Pole 30 Ampere Breaker and One Double Pole 50 Ampere Breaker
Marketing Product Description	4 Terminal Ring Type Small Closing Plate 1450 TT30 520GR Single Pedestal Direct Bury		
UPC	784572258440	Cable Entry	Underground
Length (IN)	5.313	Terminal	Double Mechanical
Width (IN)	8.688	Insulation	Glass Polyester
Height (IN)	70.25	Mounting	Pedestal
Brand Name	Milbank	Enclosure	G90 Galvanized Steel with Powder Coat Finish
Type	Ring Type Meter Socket	Jaw Quantity	4 Terminal
Special Features	Single Pole 20 Ampere Breaker and Single Pole 30 Ampere Breaker and Double Pole 50 Ampere Breaker	Bypass Type	No Bypass
Application	RV Power	Number of Meter Positions	Single Power Head
Standard	UL Listed; Type 3R	Equipment Ground	2 Barrel Ground Lug and Ground Bar
Voltage Rating	Up to 240 Volts Alternating Current	Hub Opening	Small Closing Plate
Amperage Rating	125 Continuous Ampere	Line Side Wire Range	6 AWG - 350 kcmil
Phase	1 Phase	Number Branch Circuits	2
Frequency Rating	60 Hertz	Number Of Receptacles	3
Size	5.313L x 8.688W x 70.25H	Receptacle Configuration	One NEMA 14-50 and One NEMA TT30 and One NEMA 5-20 Ground Fault
Number Of Cutouts	3		

Please consult serving utility for their requirements prior to ordering or installing, as specifications and approvals vary by utility and may require local electrical inspector approval. All installations must be installed by a licensed electrician and must comply with all national and local codes, laws and regulations. Milbank reserves the right to make changes in specifications and features shown without notice or obligation.

**FEATURE TABLE**

ITEM	QTY	DESCRIPTION
A	3	U/L MNTG.EMBOSS
B	1	5/16 SOLID K.O.
C	2	1/2, 3/4, 1, 1 1/4 CONC. K.O.

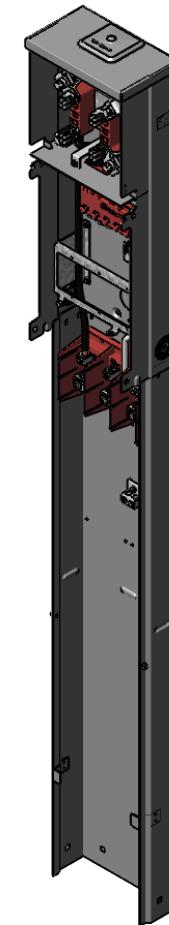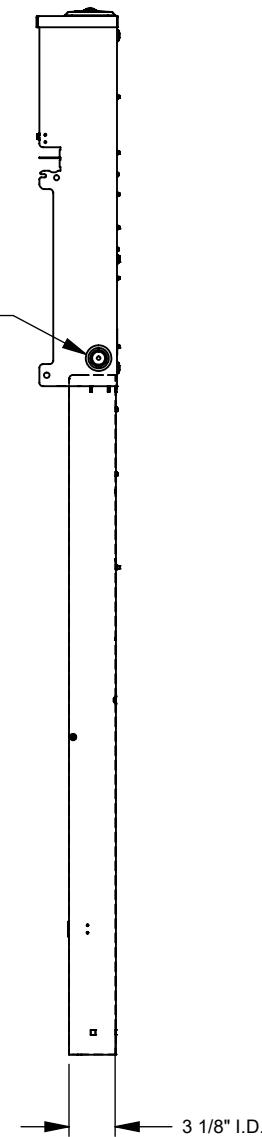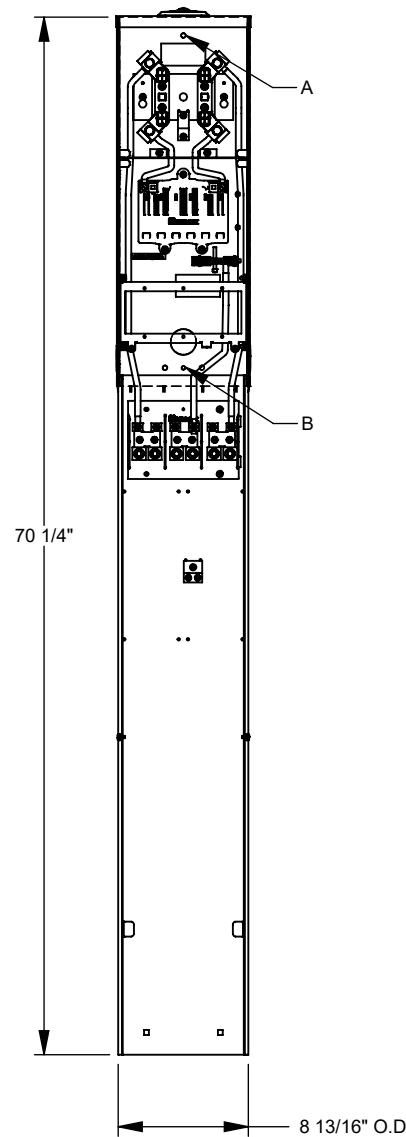

All dimensions are +/- 1/16".  
Drawing views are not to scale.

Version:

**1**

Please consult serving utility for their requirements prior to ordering or installing, as specifications and approvals vary by utility, and may require local electrical inspector approval. All installations must be installed by a licensed electrician and must comply with all national and local codes, laws and regulations. Milbank reserves the right to make changes in specifications and features shown without notice or obligation.